


TITLE				Revision	
Dual Radian				1	
FILENAME	DRAWN BY	Date	Edited By	Edited On	
NORTH AMERICAN DUAL RADIAN-1-21-16.VSD	REX L.	1/21/16			

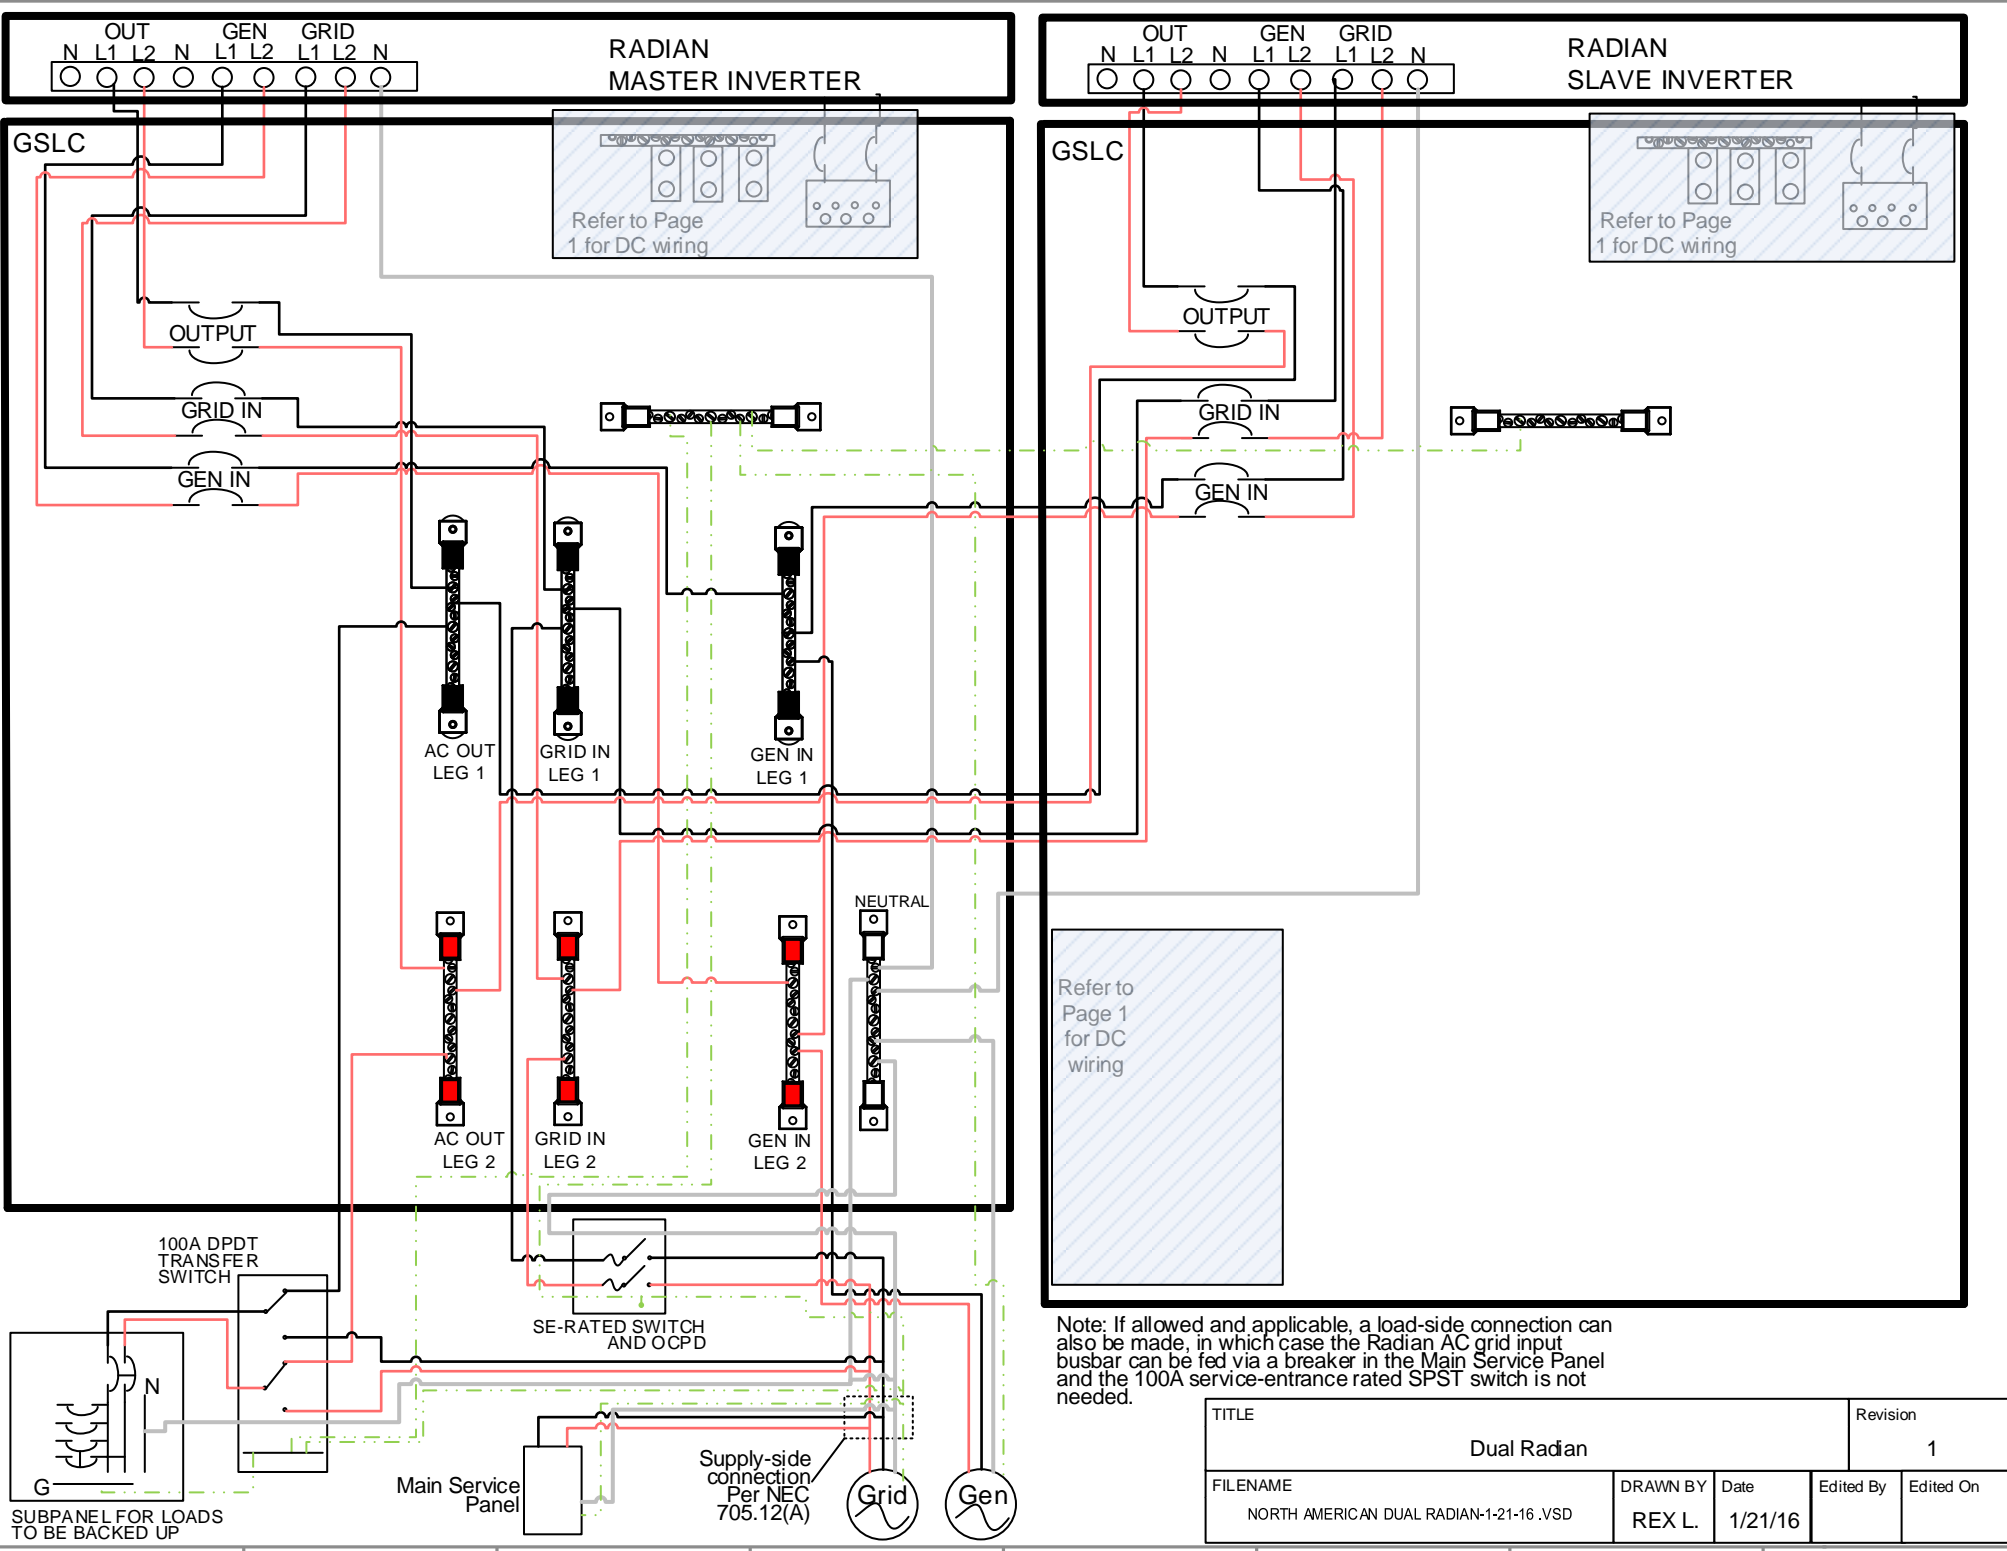

Refer to Page 1 for DC wiring

Refer to Page 1 for DC wiring

Refer to Page 1 for DC wiring

Note: If allowed and applicable, a load-side connection can also be made, in which case the Radian AC grid input busbar can be fed via a breaker in the Main Service Panel and the 100A service-entrance rated SPST switch is not needed.

TITLE				Revision	
Dual Radian				1	
FILENAME	DRAWN BY	Date	Edited By	Edited On	
NORTH AMERICAN DUAL RADIAN-1-21-16.VSD	REX L.	1/21/16			